



HISTORIC  
**FRANKLIN**  
TENNESSEE

# Wastewater Treatment Plant

## Grease Interceptor Certification (Form A)

The City of Franklin Wastewater Department is requiring that this grease interceptor certification be completed due to either identification of grease discharge or inability to determine compliance. Have your grease waste hauler complete this form to verify that all components of the grease control equipment are present and in good working condition.

Facility Name \_\_\_\_\_

Phone # \_\_\_\_\_

Address \_\_\_\_\_

City \_\_\_\_\_

State \_\_\_\_\_

Zip Code \_\_\_\_\_

	Pass	Fail *
1. Interceptor completely emptied and cleaned before inspection?	<input type="checkbox"/>	<input type="checkbox"/>
2. There is access to all interceptor chambers for cleaning and inspections?	<input type="checkbox"/>	<input type="checkbox"/>
3. Influent (inlet) T is attached and extends downward at least 2/3 depth of tank?	<input type="checkbox"/>	<input type="checkbox"/>
4. Effluent (outlet) T is attached and extends downward to within 12" of tank bottom?	<input type="checkbox"/>	<input type="checkbox"/>
5. Effluent (outlet) T is made of non – collapsible material that does <b>NOT</b> easily flex or bend (i.e. minimum schedule 40 PVC, etc.), and is secure, not allowing fats, oils or grease to escape around edges?	<input type="checkbox"/>	<input type="checkbox"/>
6. Interceptor tank does <b>NOT</b> have visible holes or leaks?	<input type="checkbox"/>	<input type="checkbox"/>
7. Mid – wall baffle(s) is secure and operational?	<input type="checkbox"/>	<input type="checkbox"/>
8. Interceptor maintaining structural integrity?	<input type="checkbox"/>	<input type="checkbox"/>
9. No Sewer clean – out covers missing or damaged?	<input type="checkbox"/>	<input type="checkbox"/>

**\*Important Required Information & Response:** If the answer to any of the above questions is "Fail", the equipment has failed certification. A statement of the plan of action to be taken, with date to be completed, needs to be provided on the attached sheet under "Response Comments" (attach additional sheets to explain corrective action if necessary).

**Inspector Certification** – This grease Interceptor has  Passed or  Failed certification.

I \_\_\_\_\_ of \_\_\_\_\_  
(print name of inspector) (print company name)

certify that the above listed facility has an approximate \_\_\_\_\_ gallon capacity interceptor. I have examined the interceptor and provided the above information.

\_\_\_\_\_  
*Inspector Signature*

\_\_\_\_\_  
*Date*

\_\_\_\_\_  
*Phone #*

### Facility Owner/Manager Certification

I \_\_\_\_\_ certify to the best of my knowledge the above statements to be true and correct.  
(print name)

\_\_\_\_\_  
*Signature*


\_\_\_\_\_  
*Date*

\_\_\_\_\_  
*Phone #*

### Submit Original Certification Form To:

City of Franklin WWTP, FOG Control Program, 135 Claude Yates Drive, Franklin, TN 37064

*Grease Interceptor Diagram*

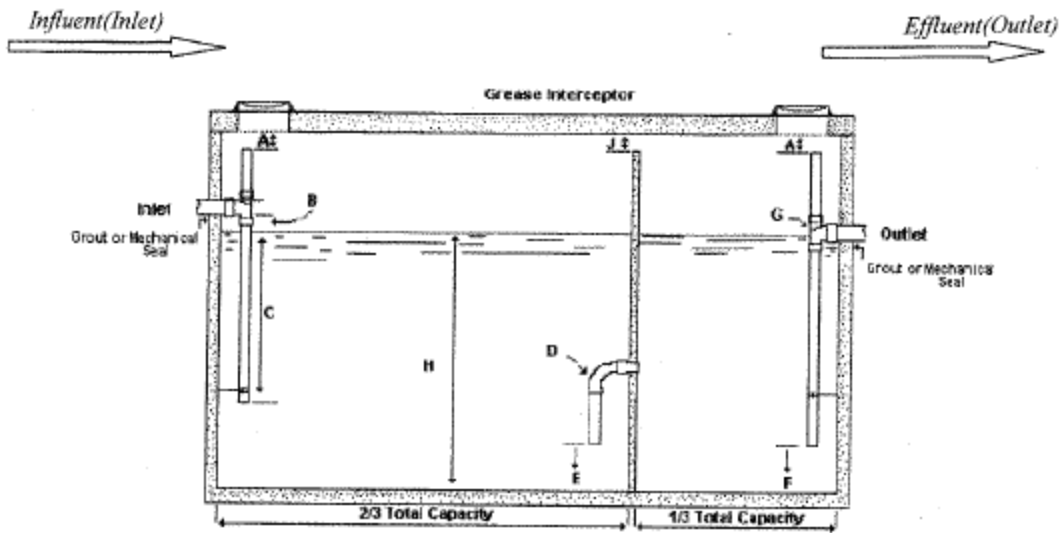

- a) Minimum 6", but not less than pipe diameter
- b) Inlet pipe invert to be 2 1/2" above liquid surface
- c) Inlet pipe to terminate 2/3 depth of water level
- d) 90° Sweep, minimum size – 6"
- e) 12" from floor to end of sweep
- f) 12" from floor to end of outlet pipe
- g) Outlet pipe no smaller than inlet pipe, minimum – 4"
- h) Minimum depth of liquid capacity – 42"
- i) Maximum distance from ceiling – 6"

Response Comments (required if "Fail" checked, identify problem, corrective action and provide planned date of corrective action)

---



---



---



---



---



---



---



---



---



---

**Submit Original Certification Form To:**

City of Franklin WWTP, FOG Control Program, 135 Claude Yates Drive, Franklin, TN 37064